
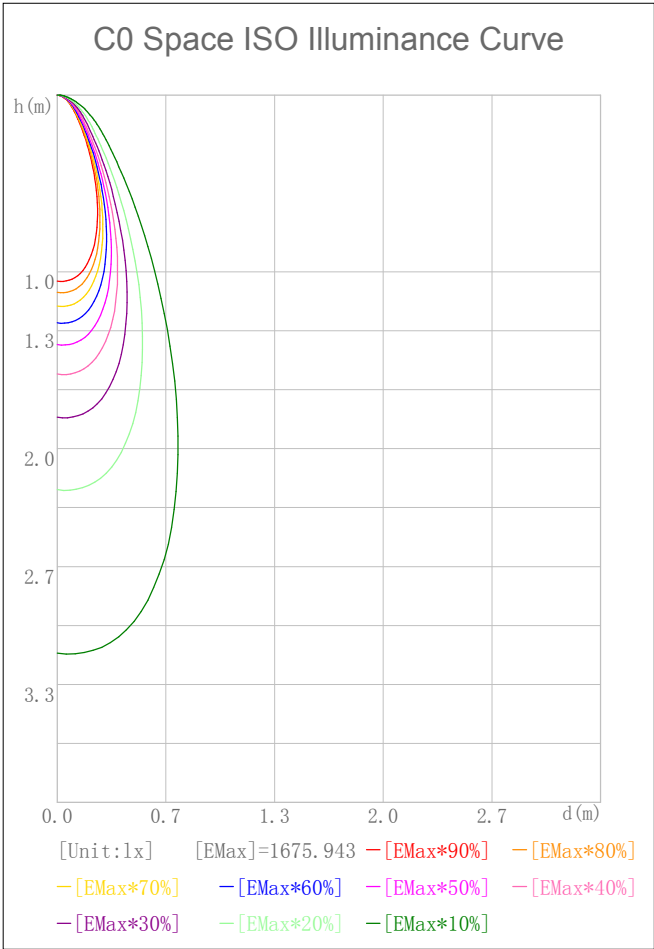



Indoor Luminaire Photometric Data

Character Parameter

Lamp Speciality Parameter		Luminaire Speciality Parameter	
Rated Flux(lm):	753.000	Luminary Flux(lm):	822.460
Rated Power(W):		Luminary Efficiency:	109.22%
Rated Voltage(V):		Luminary EER(lm/W):	94.060
Tested Power(W):	8.744	Max. Candela(cd):	1676.709
Lamps' Inside:	1	Max Cand@Ang. (°):	C=0.0 γ=1.0
Tested Electrics(V, A, pf):	240.2, 0.040, 0.902	Beam Angle(50%Imax):	36.5(°)
Lamp Size(W*L*H):	0.050m*0.000m*0.000m	Left=-16.5°, Right=20.0°	IRF(%):
			422.586

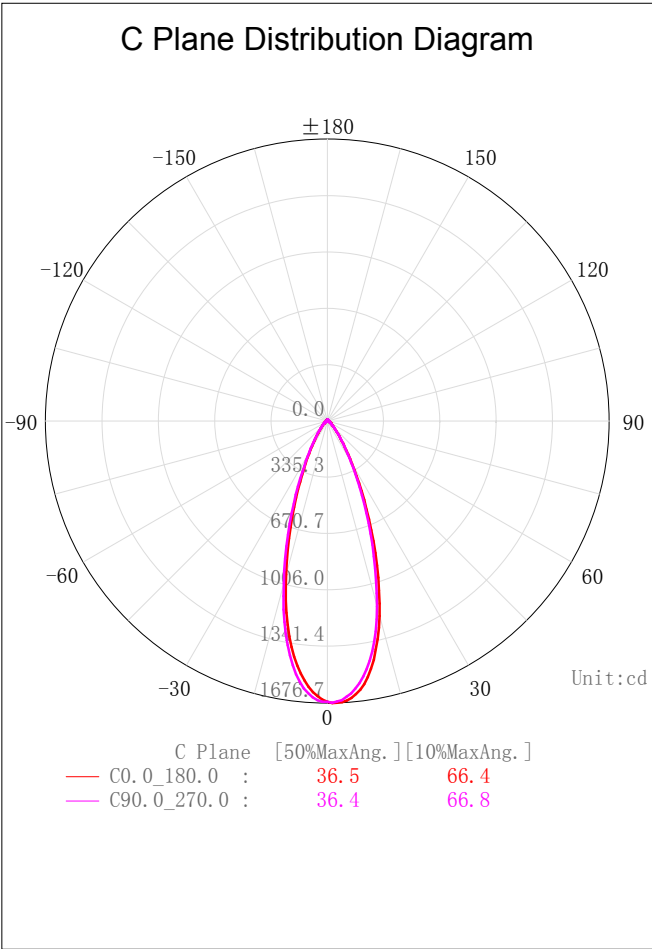


2D Plane Light Intensity Distribution Curve

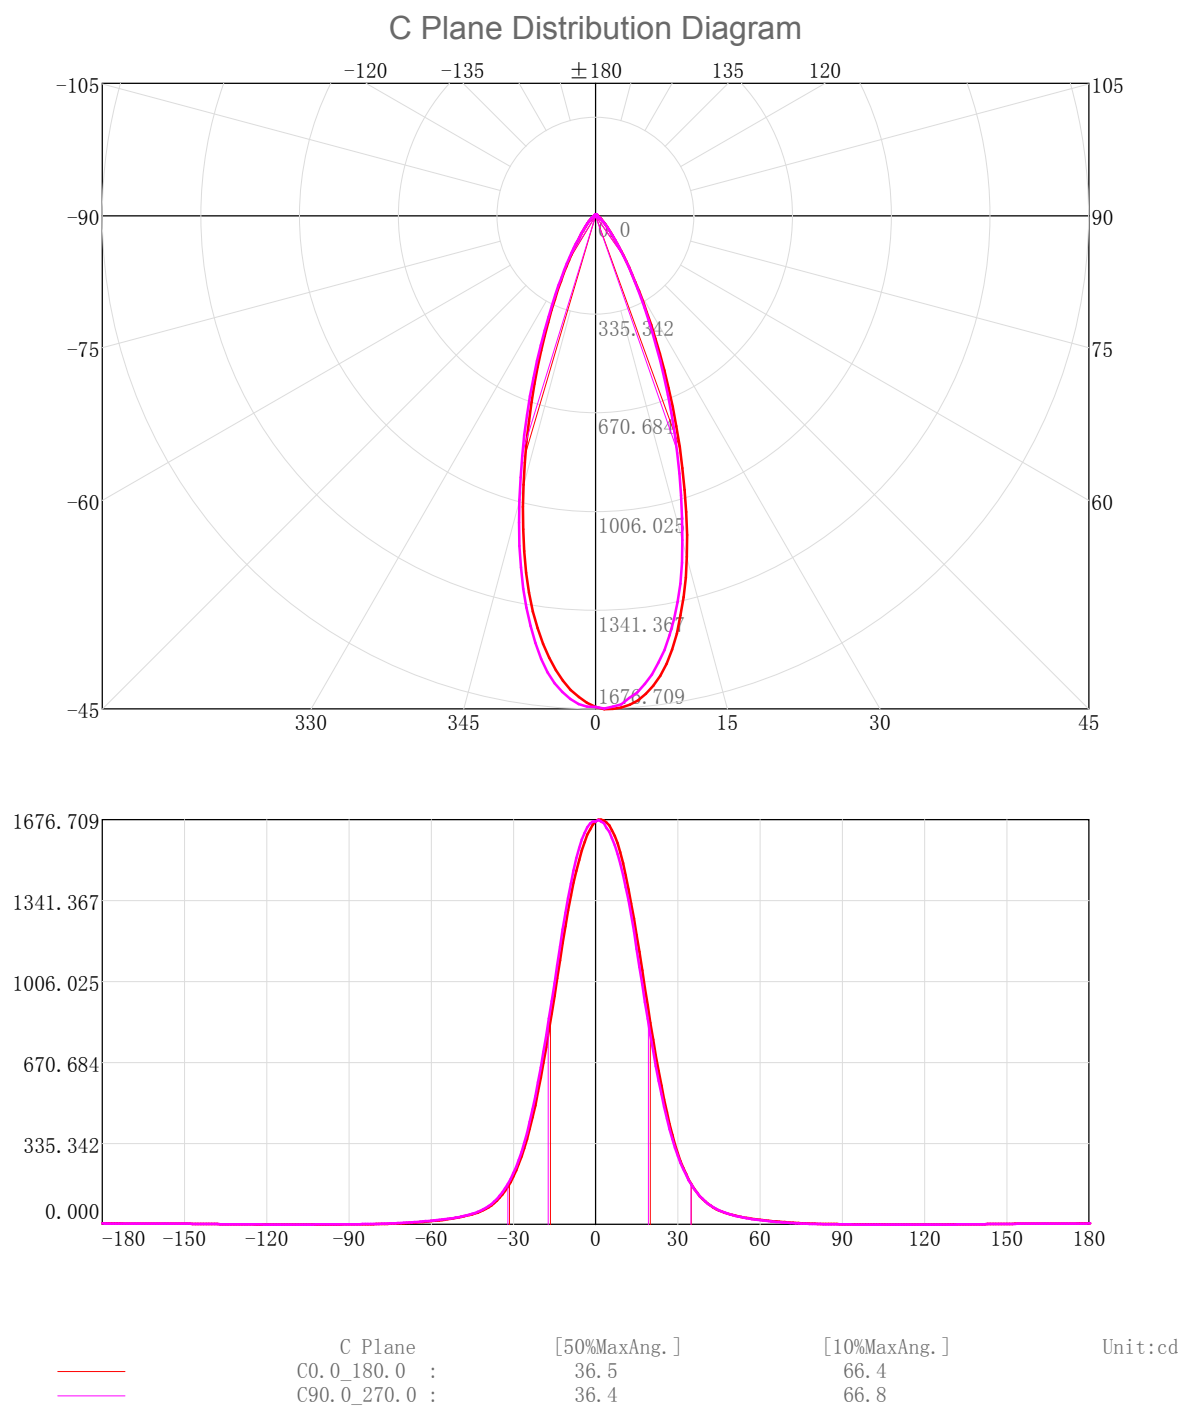

3D Light Intensity Distribution Modal

3D Light Intensity Distribution Modal

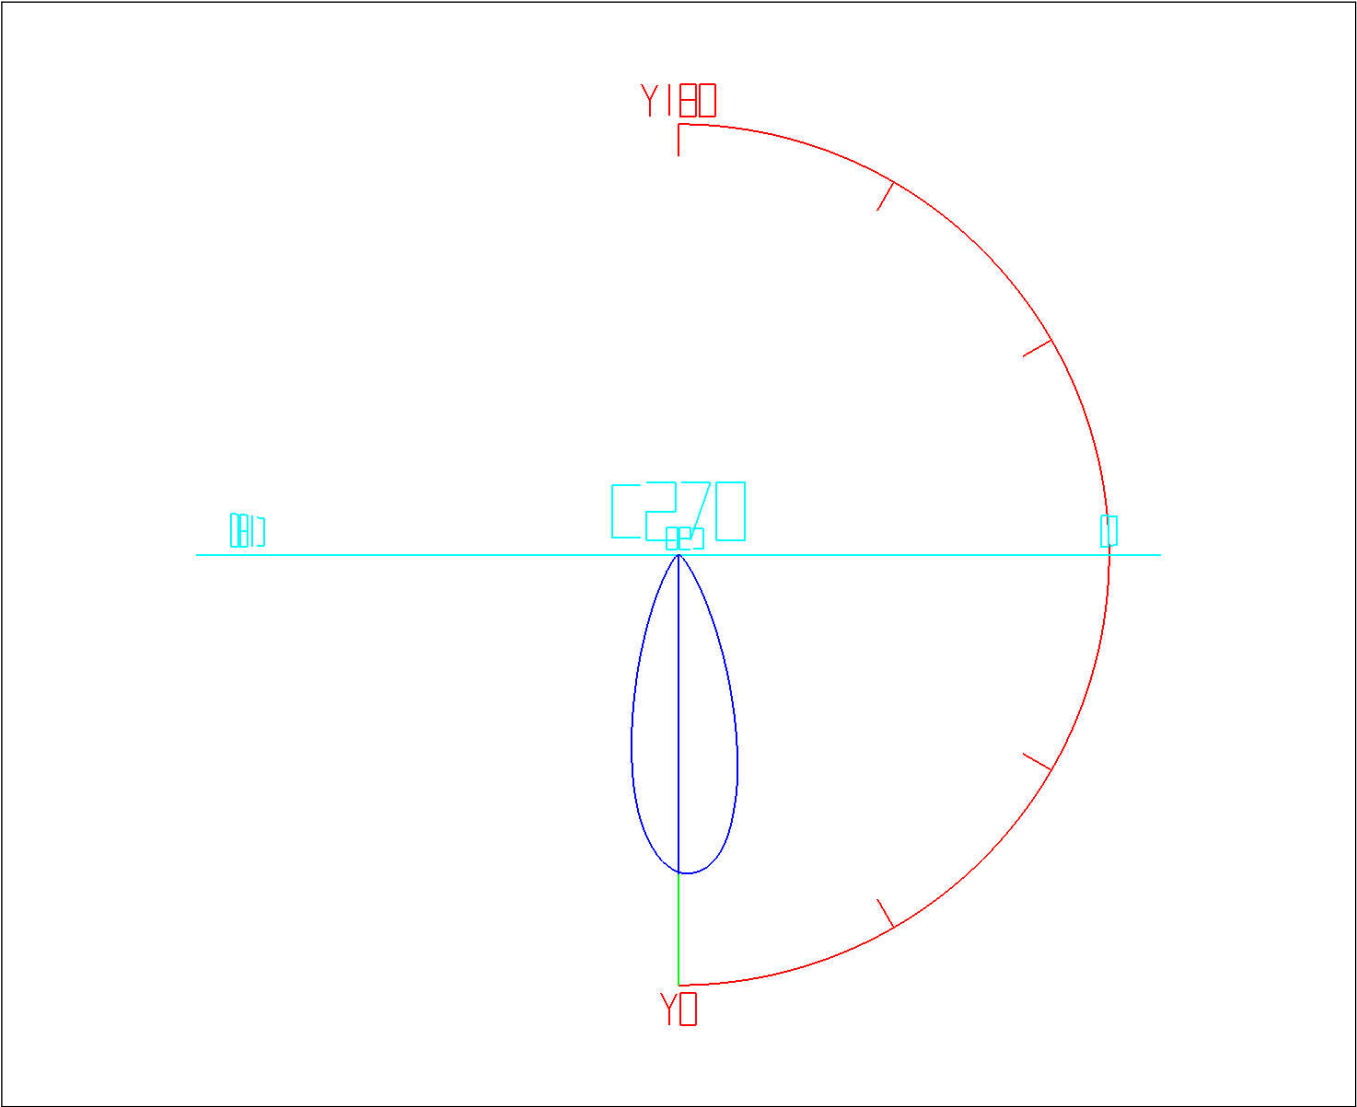

Curves: 3D Model — Fixture — Vert. HUD — Hori. HUD —
View Angles: Orient:0 Tilt:0 Roll:0 Spin:0


Zonal Flux Tabulation

Zone (γ)	Zone Flux (lm)	Sums Flux (lm)	Zone%Lamp	Sums%Lamp	Zone (γ)	Zone Flux (lm)	Sums Flux (lm)	Zone%Lamp	Sums%Lamp
0.0-1.0	1.60	1.60	0.21	0.21	47.0-48.0	3.39	766.89	0.45	101.84
1.0-2.0	4.78	6.38	0.63	0.85	48.0-49.0	3.19	770.07	0.42	102.27
2.0-3.0	7.91	14.29	1.05	1.90	49.0-50.0	3.00	773.08	0.40	102.67
3.0-4.0	10.97	25.26	1.46	3.35	50.0-51.0	2.83	775.91	0.38	103.04
4.0-5.0	13.91	39.17	1.85	5.20	51.0-52.0	2.67	778.58	0.35	103.40
5.0-6.0	16.72	55.89	2.22	7.42	52.0-53.0	2.52	781.11	0.33	103.73
6.0-7.0	19.34	75.24	2.57	9.99	53.0-54.0	2.38	783.49	0.32	104.05
7.0-8.0	21.75	96.99	2.89	12.88	54.0-55.0	2.25	785.73	0.30	104.35
8.0-9.0	23.91	120.90	3.18	16.06	55.0-56.0	2.12	787.85	0.28	104.63
9.0-10.0	25.80	146.71	3.43	19.48	56.0-57.0	2.00	789.85	0.27	104.89
10.0-11.0	27.39	174.10	3.64	23.12	57.0-58.0	1.89	791.74	0.25	105.14
11.0-12.0	28.66	202.76	3.81	26.93	58.0-59.0	1.78	793.51	0.24	105.38
12.0-13.0	29.59	232.35	3.93	30.86	59.0-60.0	1.67	795.18	0.22	105.60
13.0-14.0	30.19	262.54	4.01	34.87	60.0-61.0	1.57	796.75	0.21	105.81
14.0-15.0	30.42	292.95	4.04	38.91	61.0-62.0	1.47	798.22	0.20	106.01
15.0-16.0	30.33	323.28	4.03	42.93	62.0-63.0	1.38	799.60	0.18	106.19
16.0-17.0	29.96	353.24	3.98	46.91	63.0-64.0	1.29	800.88	0.17	106.36
17.0-18.0	29.35	382.60	3.90	50.81	64.0-65.0	1.20	802.08	0.16	106.52
18.0-19.0	28.55	411.14	3.79	54.60	65.0-66.0	1.11	803.19	0.15	106.67
19.0-20.0	27.57	438.71	3.66	58.26	66.0-67.0	1.03	804.22	0.14	106.80
20.0-21.0	26.42	465.13	3.51	61.77	67.0-68.0	0.95	805.18	0.13	106.93
21.0-22.0	25.15	490.28	3.34	65.11	68.0-69.0	0.88	806.06	0.12	107.05
22.0-23.0	23.78	514.06	3.16	68.27	69.0-70.0	0.81	806.87	0.11	107.15
23.0-24.0	22.35	536.41	2.97	71.24	70.0-71.0	0.74	807.61	0.10	107.25
24.0-25.0	20.90	557.31	2.78	74.01	71.0-72.0	0.69	808.30	0.09	107.34
25.0-26.0	19.46	576.77	2.58	76.60	72.0-73.0	0.63	808.92	0.08	107.43
26.0-27.0	18.06	594.84	2.40	79.00	73.0-74.0	0.57	809.50	0.08	107.50
27.0-28.0	16.71	611.55	2.22	81.21	74.0-75.0	0.52	810.02	0.07	107.57
28.0-29.0	15.41	626.96	2.05	83.26	75.0-76.0	0.47	810.49	0.06	107.63
29.0-30.0	14.20	641.16	1.89	85.15	76.0-77.0	0.42	810.91	0.06	107.69
30.0-31.0	13.05	654.20	1.73	86.88	77.0-78.0	0.38	811.29	0.05	107.74
31.0-32.0	11.97	666.18	1.59	88.47	78.0-79.0	0.34	811.64	0.05	107.79
32.0-33.0	10.98	677.15	1.46	89.93	79.0-80.0	0.31	811.95	0.04	107.83
33.0-34.0	10.06	687.21	1.34	91.26	80.0-81.0	0.29	812.24	0.04	107.87
34.0-35.0	9.21	696.42	1.22	92.49	81.0-82.0	0.27	812.51	0.04	107.90
35.0-36.0	8.44	704.86	1.12	93.61	82.0-83.0	0.25	812.76	0.03	107.94
36.0-37.0	7.72	712.58	1.03	94.63	83.0-84.0	0.24	813.00	0.03	107.97
37.0-38.0	7.08	719.67	0.94	95.57	84.0-85.0	0.22	813.22	0.03	108.00
38.0-39.0	6.51	726.18	0.86	96.44	85.0-86.0	0.20	813.42	0.03	108.02
39.0-40.0	5.99	732.17	0.80	97.23	86.0-87.0	0.19	813.61	0.02	108.05
40.0-41.0	5.52	737.69	0.73	97.97	87.0-88.0	0.17	813.78	0.02	108.07
41.0-42.0	5.11	742.80	0.68	98.65	88.0-89.0	0.16	813.94	0.02	108.09
42.0-43.0	4.74	747.54	0.63	99.27	89.0-90.0	0.14	814.08	0.02	108.11
43.0-44.0	4.40	751.94	0.58	99.86	90.0-91.0	0.13	814.21	0.02	108.13
44.0-45.0	4.11	756.05	0.55	100.40	91.0-92.0	0.12	814.33	0.02	108.14
45.0-46.0	3.84	759.89	0.51	100.92	92.0-93.0	0.11	814.44	0.01	108.16
46.0-47.0	3.60	763.50	0.48	101.39	93.0-94.0	0.10	814.54	0.01	108.17


Zonal Flux Tabulation - (Cont.)

Zone (γ)	Zone Flux (lm)	Sums Flux (lm)	Zone%Lamp	Sums%Lamp	Zone (γ)	Zone Flux (lm)	Sums Flux (lm)	Zone%Lamp	Sums%Lamp
94. 0-95. 0	0. 10	814. 64	0. 01	108. 19	141. 0-142. 0	0. 15	817. 71	0. 02	108. 59
95. 0-96. 0	0. 09	814. 73	0. 01	108. 20	142. 0-143. 0	0. 16	817. 86	0. 02	108. 61
96. 0-97. 0	0. 08	814. 81	0. 01	108. 21	143. 0-144. 0	0. 16	818. 02	0. 02	108. 64
97. 0-98. 0	0. 08	814. 89	0. 01	108. 22	144. 0-145. 0	0. 17	818. 19	0. 02	108. 66
98. 0-99. 0	0. 07	814. 96	0. 01	108. 23	145. 0-146. 0	0. 17	818. 36	0. 02	108. 68
99. 0-100. 0	0. 07	815. 03	0. 01	108. 24	146. 0-147. 0	0. 17	818. 53	0. 02	108. 70
100. 0-101. 0	0. 06	815. 09	0. 01	108. 25	147. 0-148. 0	0. 18	818. 71	0. 02	108. 73
101. 0-102. 0	0. 06	815. 15	0. 01	108. 25	148. 0-149. 0	0. 18	818. 89	0. 02	108. 75
102. 0-103. 0	0. 05	815. 20	0. 01	108. 26	149. 0-150. 0	0. 18	819. 06	0. 02	108. 77
103. 0-104. 0	0. 05	815. 25	0. 01	108. 27	150. 0-151. 0	0. 18	819. 24	0. 02	108. 80
104. 0-105. 0	0. 05	815. 30	0. 01	108. 27	151. 0-152. 0	0. 18	819. 42	0. 02	108. 82
105. 0-106. 0	0. 04	815. 34	0. 01	108. 28	152. 0-153. 0	0. 18	819. 60	0. 02	108. 85
106. 0-107. 0	0. 04	815. 39	0. 01	108. 28	153. 0-154. 0	0. 18	819. 78	0. 02	108. 87
107. 0-108. 0	0. 04	815. 42	0. 01	108. 29	154. 0-155. 0	0. 18	819. 96	0. 02	108. 89
108. 0-109. 0	0. 04	815. 46	0. 00	108. 29	155. 0-156. 0	0. 17	820. 14	0. 02	108. 92
109. 0-110. 0	0. 03	815. 49	0. 00	108. 30	156. 0-157. 0	0. 17	820. 31	0. 02	108. 94
110. 0-111. 0	0. 03	815. 52	0. 00	108. 30	157. 0-158. 0	0. 17	820. 47	0. 02	108. 96
111. 0-112. 0	0. 03	815. 56	0. 00	108. 31	158. 0-159. 0	0. 16	820. 64	0. 02	108. 98
112. 0-113. 0	0. 03	815. 58	0. 00	108. 31	159. 0-160. 0	0. 16	820. 80	0. 02	109. 00
113. 0-114. 0	0. 03	815. 61	0. 00	108. 32	160. 0-161. 0	0. 15	820. 95	0. 02	109. 02
114. 0-115. 0	0. 03	815. 64	0. 00	108. 32	161. 0-162. 0	0. 15	821. 10	0. 02	109. 04
115. 0-116. 0	0. 03	815. 67	0. 00	108. 32	162. 0-163. 0	0. 14	821. 24	0. 02	109. 06
116. 0-117. 0	0. 03	815. 70	0. 00	108. 33	163. 0-164. 0	0. 13	821. 37	0. 02	109. 08
117. 0-118. 0	0. 03	815. 73	0. 00	108. 33	164. 0-165. 0	0. 13	821. 50	0. 02	109. 10
118. 0-119. 0	0. 03	815. 76	0. 00	108. 34	165. 0-166. 0	0. 12	821. 62	0. 02	109. 11
119. 0-120. 0	0. 03	815. 80	0. 00	108. 34	166. 0-167. 0	0. 11	821. 73	0. 01	109. 13
120. 0-121. 0	0. 04	815. 83	0. 00	108. 34	167. 0-168. 0	0. 11	821. 84	0. 01	109. 14
121. 0-122. 0	0. 04	815. 87	0. 01	108. 35	168. 0-169. 0	0. 10	821. 94	0. 01	109. 15
122. 0-123. 0	0. 04	815. 91	0. 01	108. 35	169. 0-170. 0	0. 09	822. 03	0. 01	109. 17
123. 0-124. 0	0. 04	815. 96	0. 01	108. 36	170. 0-171. 0	0. 08	822. 11	0. 01	109. 18
124. 0-125. 0	0. 05	816. 01	0. 01	108. 37	171. 0-172. 0	0. 07	822. 18	0. 01	109. 19
125. 0-126. 0	0. 05	816. 06	0. 01	108. 37	172. 0-173. 0	0. 06	822. 24	0. 01	109. 20
126. 0-127. 0	0. 06	816. 12	0. 01	108. 38	173. 0-174. 0	0. 06	822. 30	0. 01	109. 20
127. 0-128. 0	0. 06	816. 18	0. 01	108. 39	174. 0-175. 0	0. 05	822. 35	0. 01	109. 21
128. 0-129. 0	0. 07	816. 25	0. 01	108. 40	175. 0-176. 0	0. 04	822. 39	0. 01	109. 21
129. 0-130. 0	0. 07	816. 32	0. 01	108. 41	176. 0-177. 0	0. 03	822. 42	0. 00	109. 22
130. 0-131. 0	0. 08	816. 40	0. 01	108. 42	177. 0-178. 0	0. 02	822. 44	0. 00	109. 22
131. 0-132. 0	0. 09	816. 48	0. 01	108. 43	178. 0-179. 0	0. 01	822. 46	0. 00	109. 22
132. 0-133. 0	0. 09	816. 58	0. 01	108. 44	179. 0-180. 0	0. 00	822. 46	0. 00	109. 22
133. 0-134. 0	0. 10	816. 68	0. 01	108. 46					
134. 0-135. 0	0. 11	816. 78	0. 01	108. 47					
135. 0-136. 0	0. 11	816. 89	0. 01	108. 49					
136. 0-137. 0	0. 12	817. 01	0. 02	108. 50					
137. 0-138. 0	0. 13	817. 14	0. 02	108. 52					
138. 0-139. 0	0. 13	817. 27	0. 02	108. 54					
139. 0-140. 0	0. 14	817. 41	0. 02	108. 55					
140. 0-141. 0	0. 15	817. 56	0. 02	108. 57					

Rectangle ISO Lighting Intensity Diagram

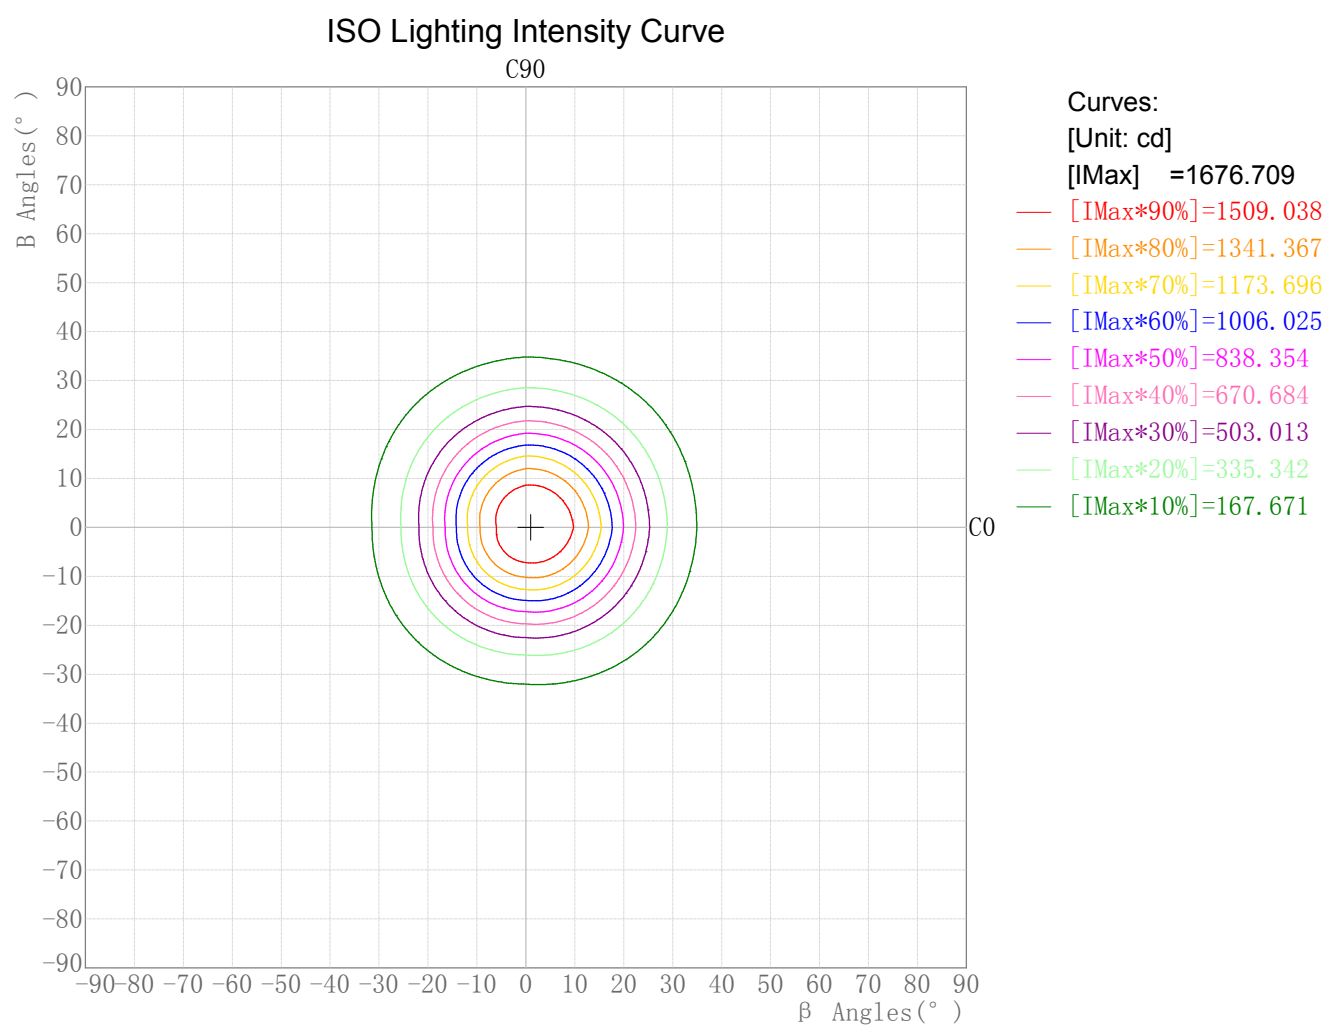


Plane ISO-Illuminance Diagram

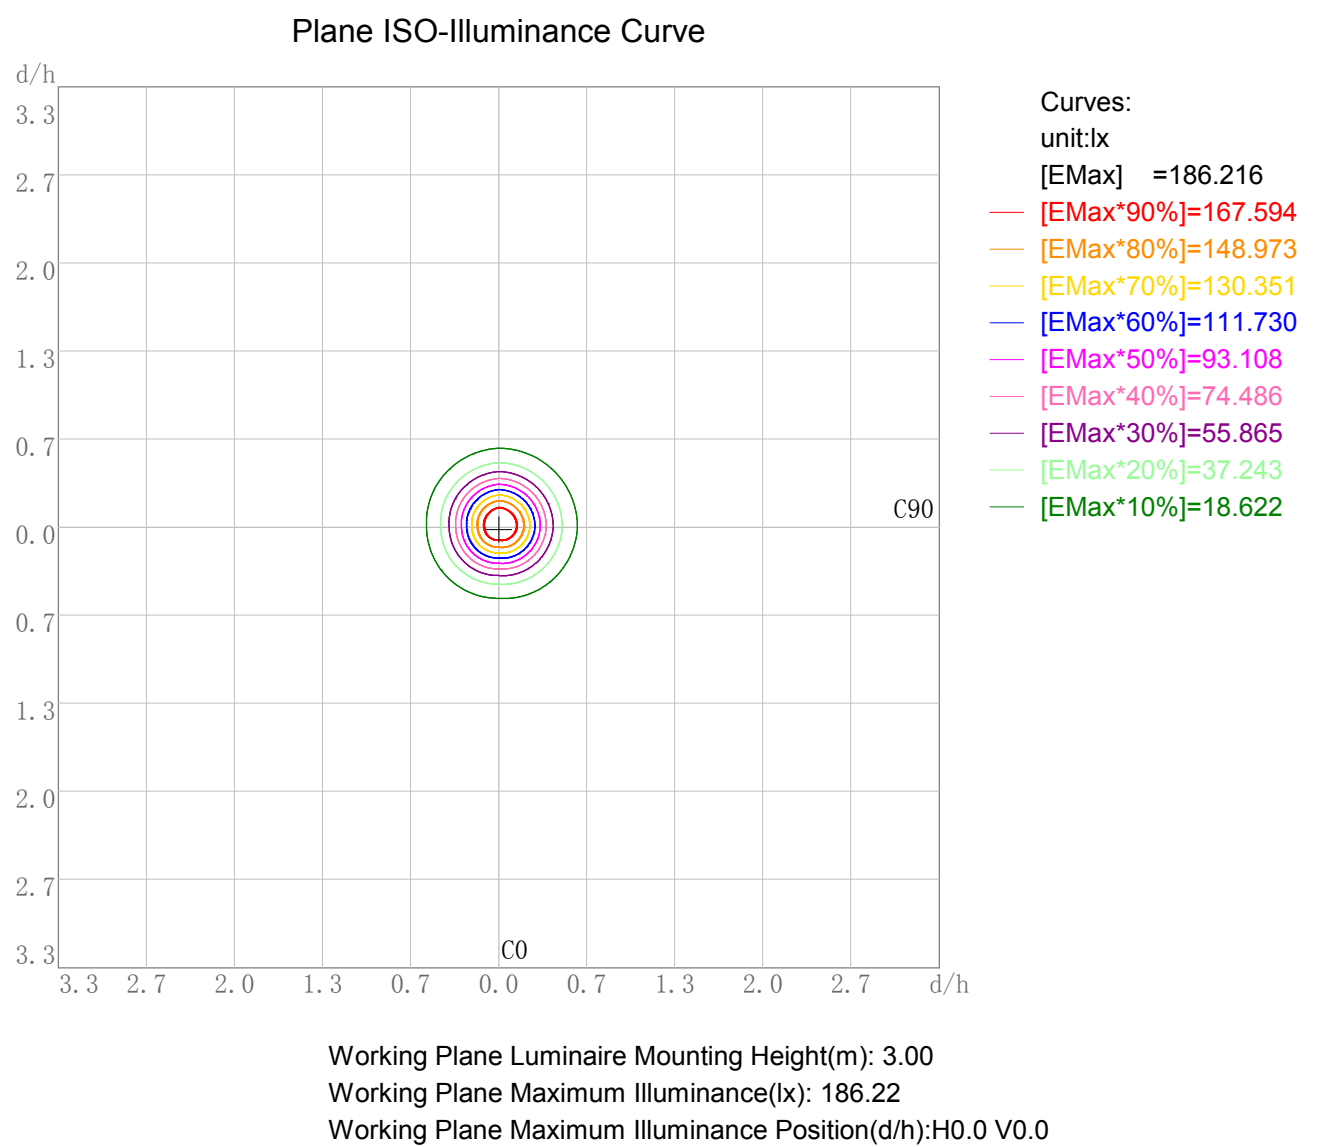


3D Plane ISO Illuminance Diagram

3D Plane Illuminance Modal

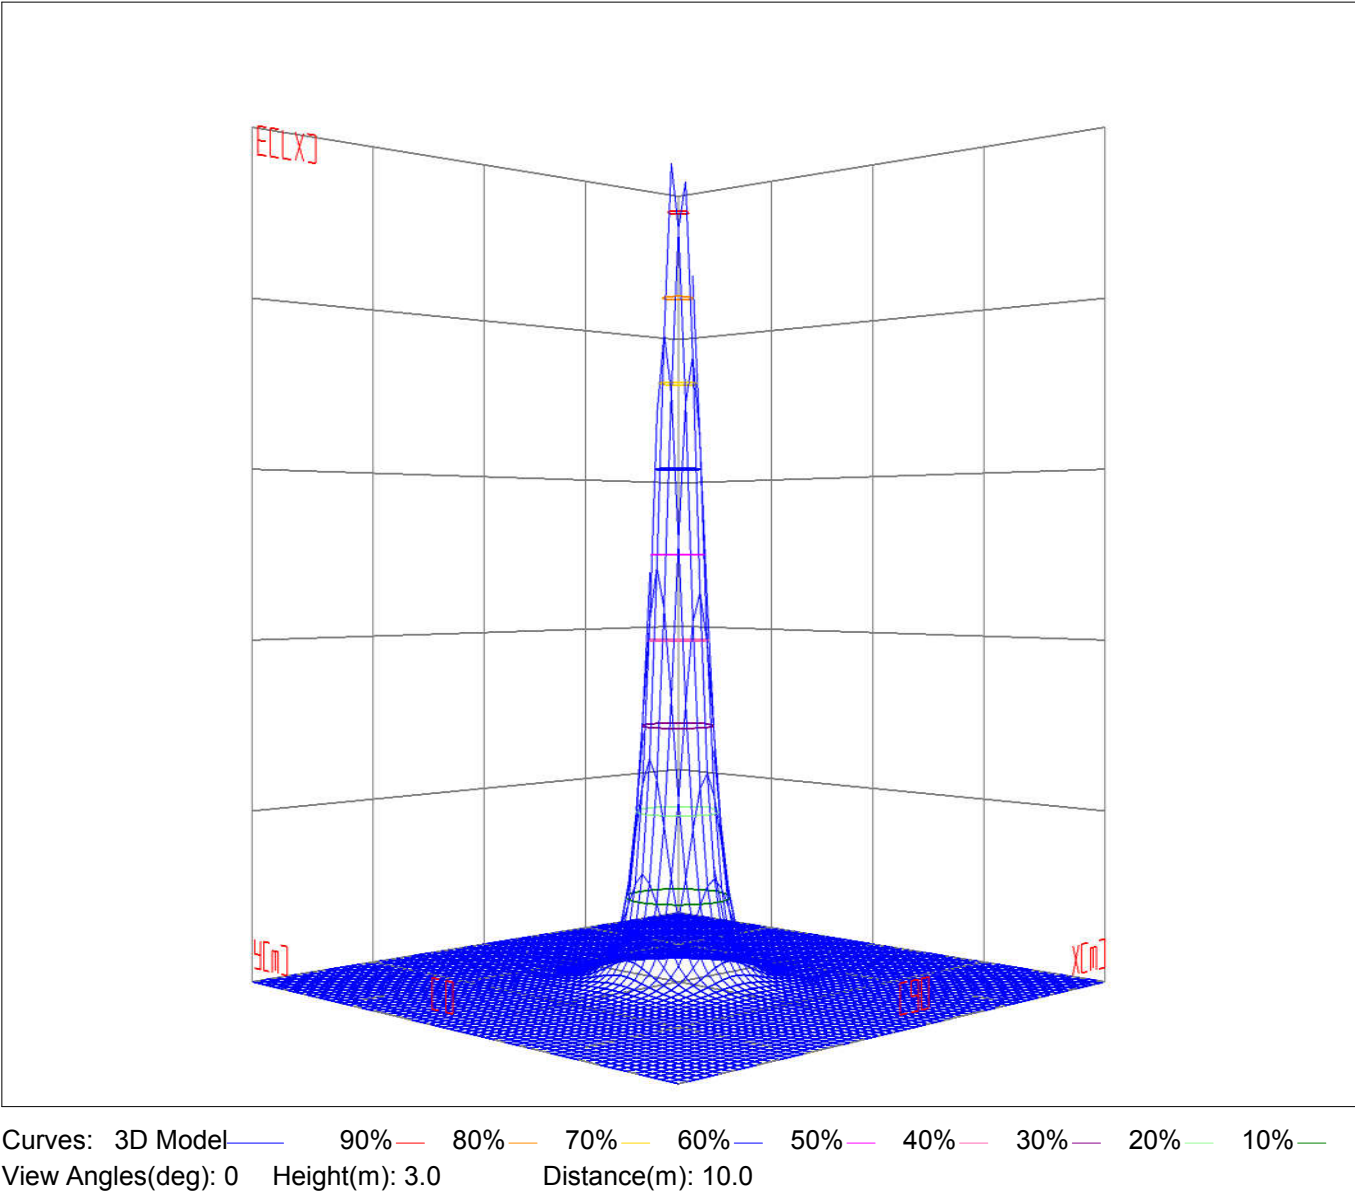


Space ISO Illuminance Diagram

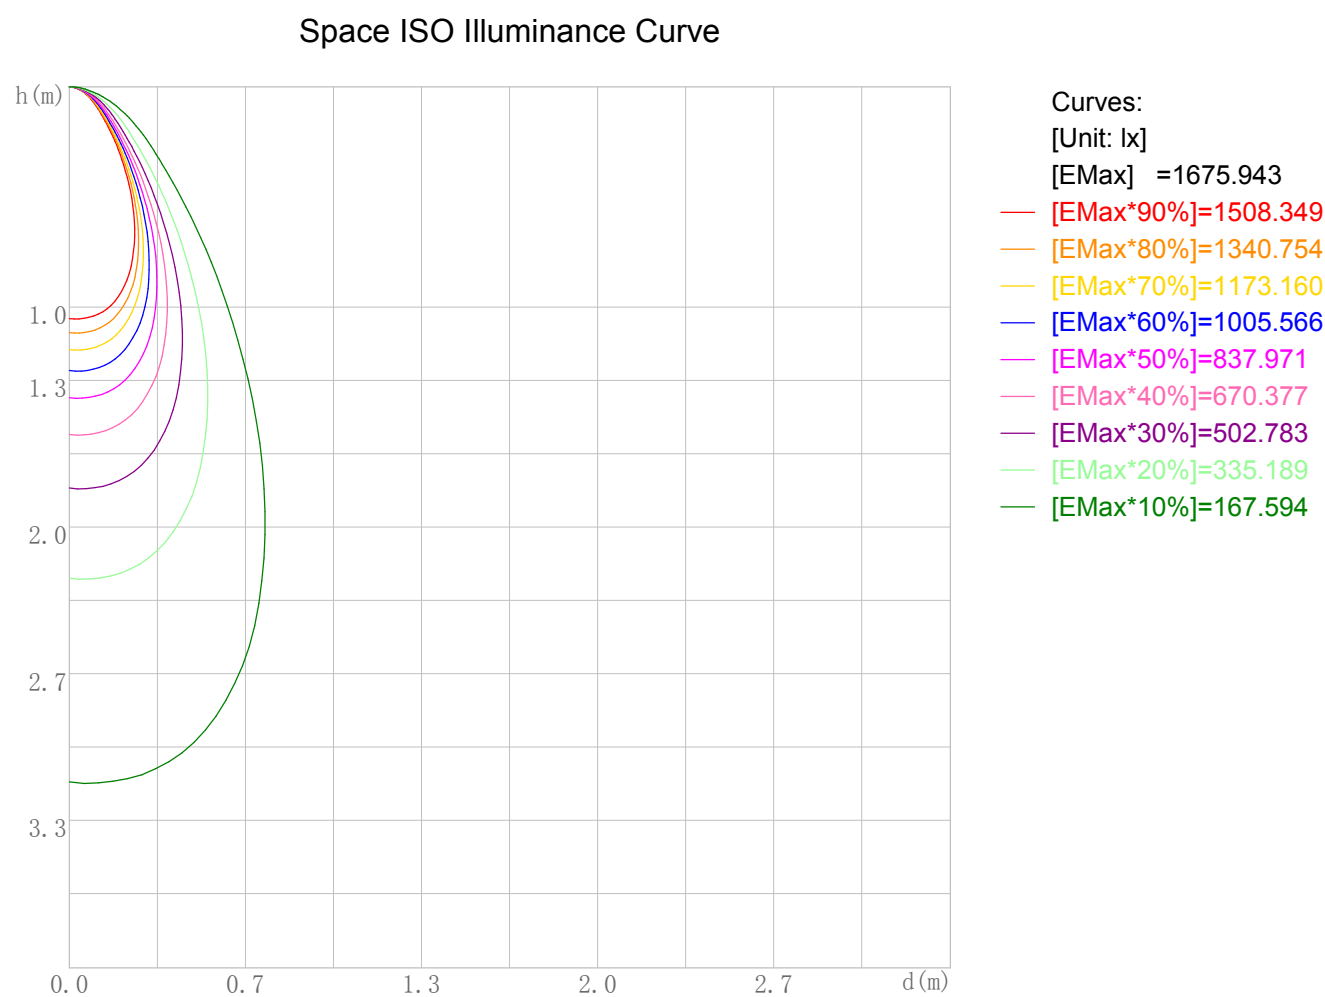

Space Plane Maximum Illuminance and @Angle:1675.94lx,1.0deg
Plane Maximum Lighting Intensity and @Angle:1676.709cd,0deg

Illuminance-Distance Diagram

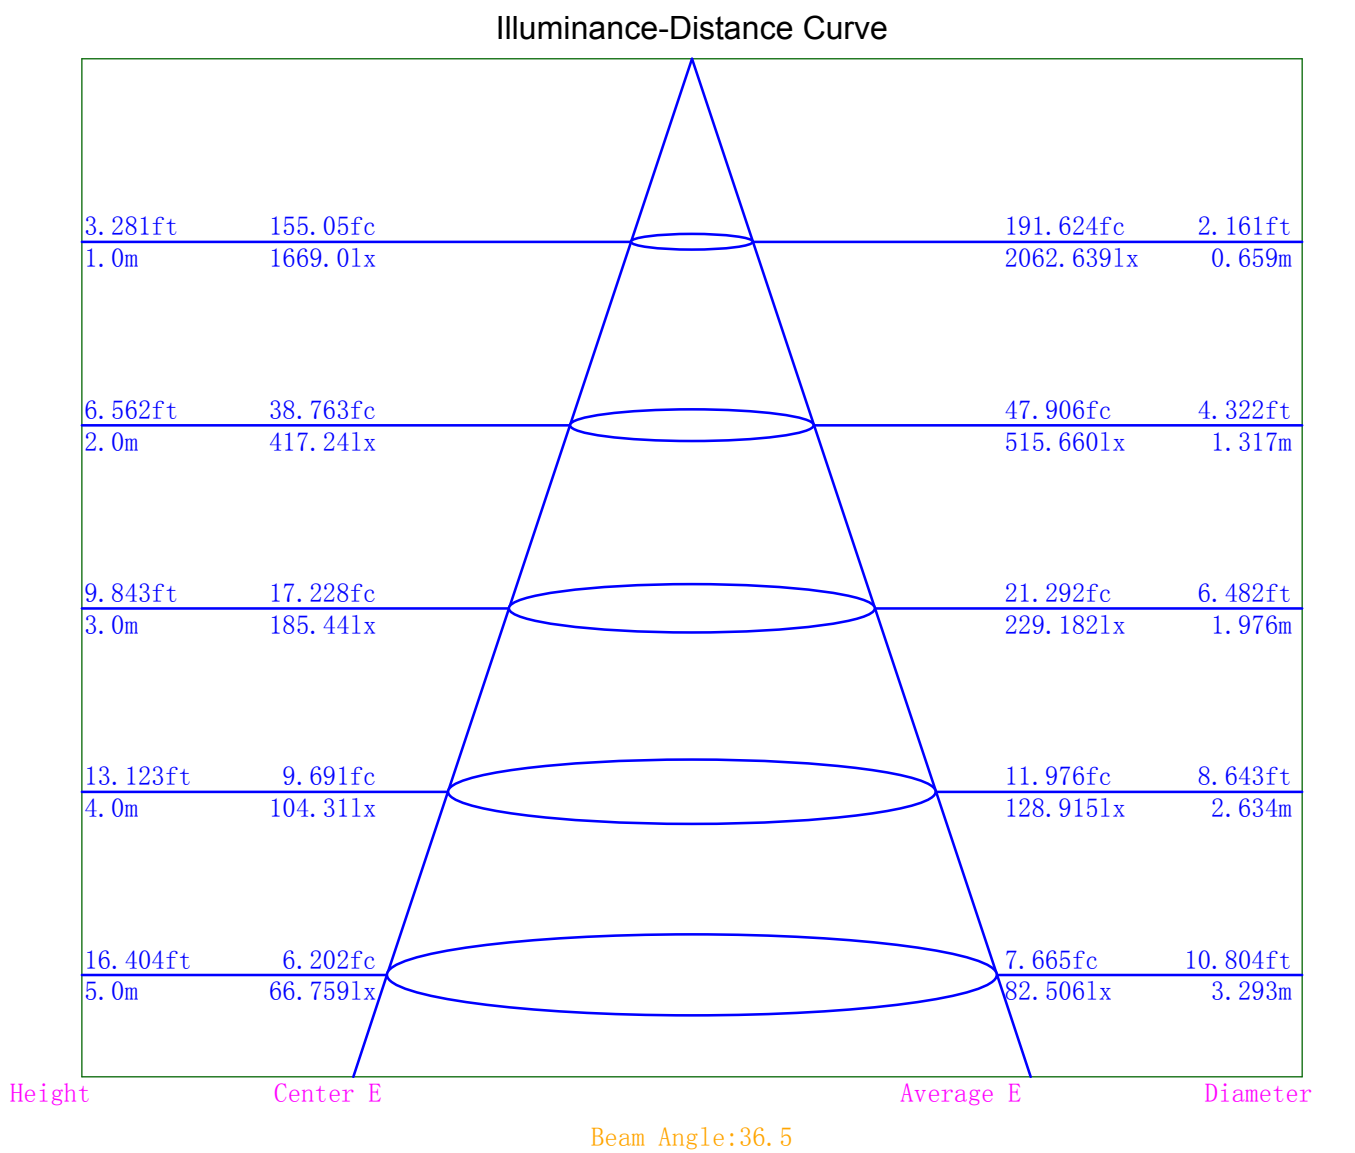

Indoor Luminance Limiting Curves


Glare Grade Table

GI	Quality	Using Illuminance							
1.15	A	2000	1000	500	<=300				
1.5	B		2000	1000	500	<=300			
1.85	C			2000	1000	500	<=300		
2.2	D				2000	1000	500	<=300	
2.55	E	a				2000	1000	500	<=300
			b	c	d	e	f	g	h

Luminance Table


Gama (deg)	45	50	55	60	65	70	75	80	85
C0	42245	31450	24657	19979	16533	13564	11704	10497	14813
C90	42779	31052	23783	18663	14687	11222	8861	7156	9665

Luminance Limiting Curve

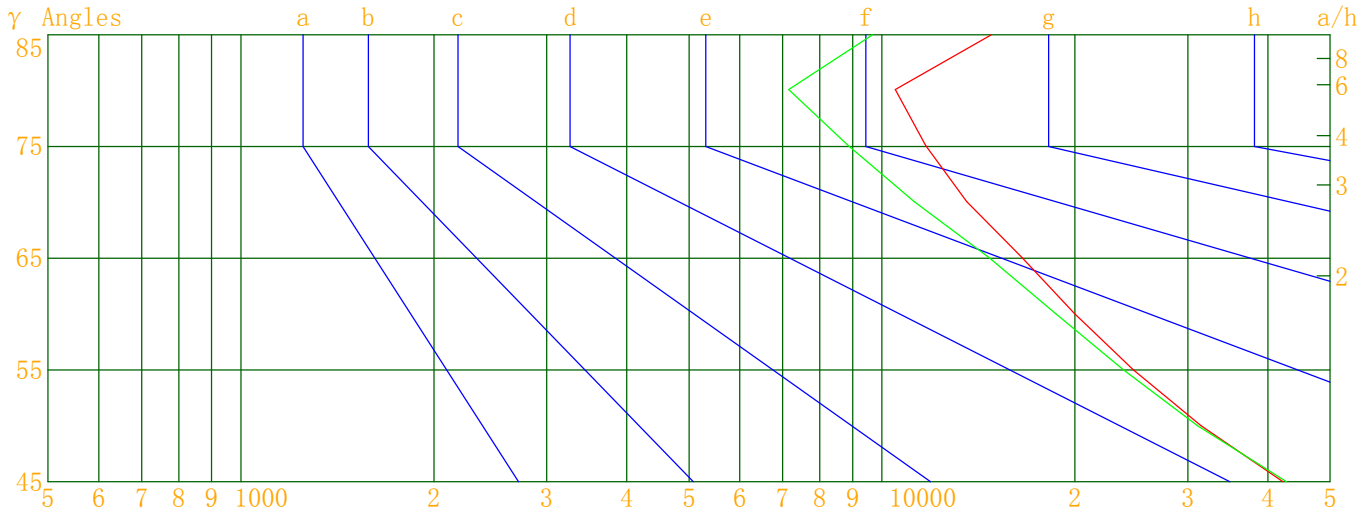

Luminous Size: Length(m)=0.000 Width(m)=-0.050 Height(m)=0.000 Area(m^2)=0.001963
Luminous Type: Without Luminous Side
Luminous Curves: C0-C180 Color: — C90-C270 Color: —

Indoor Budgetary Estimate Table

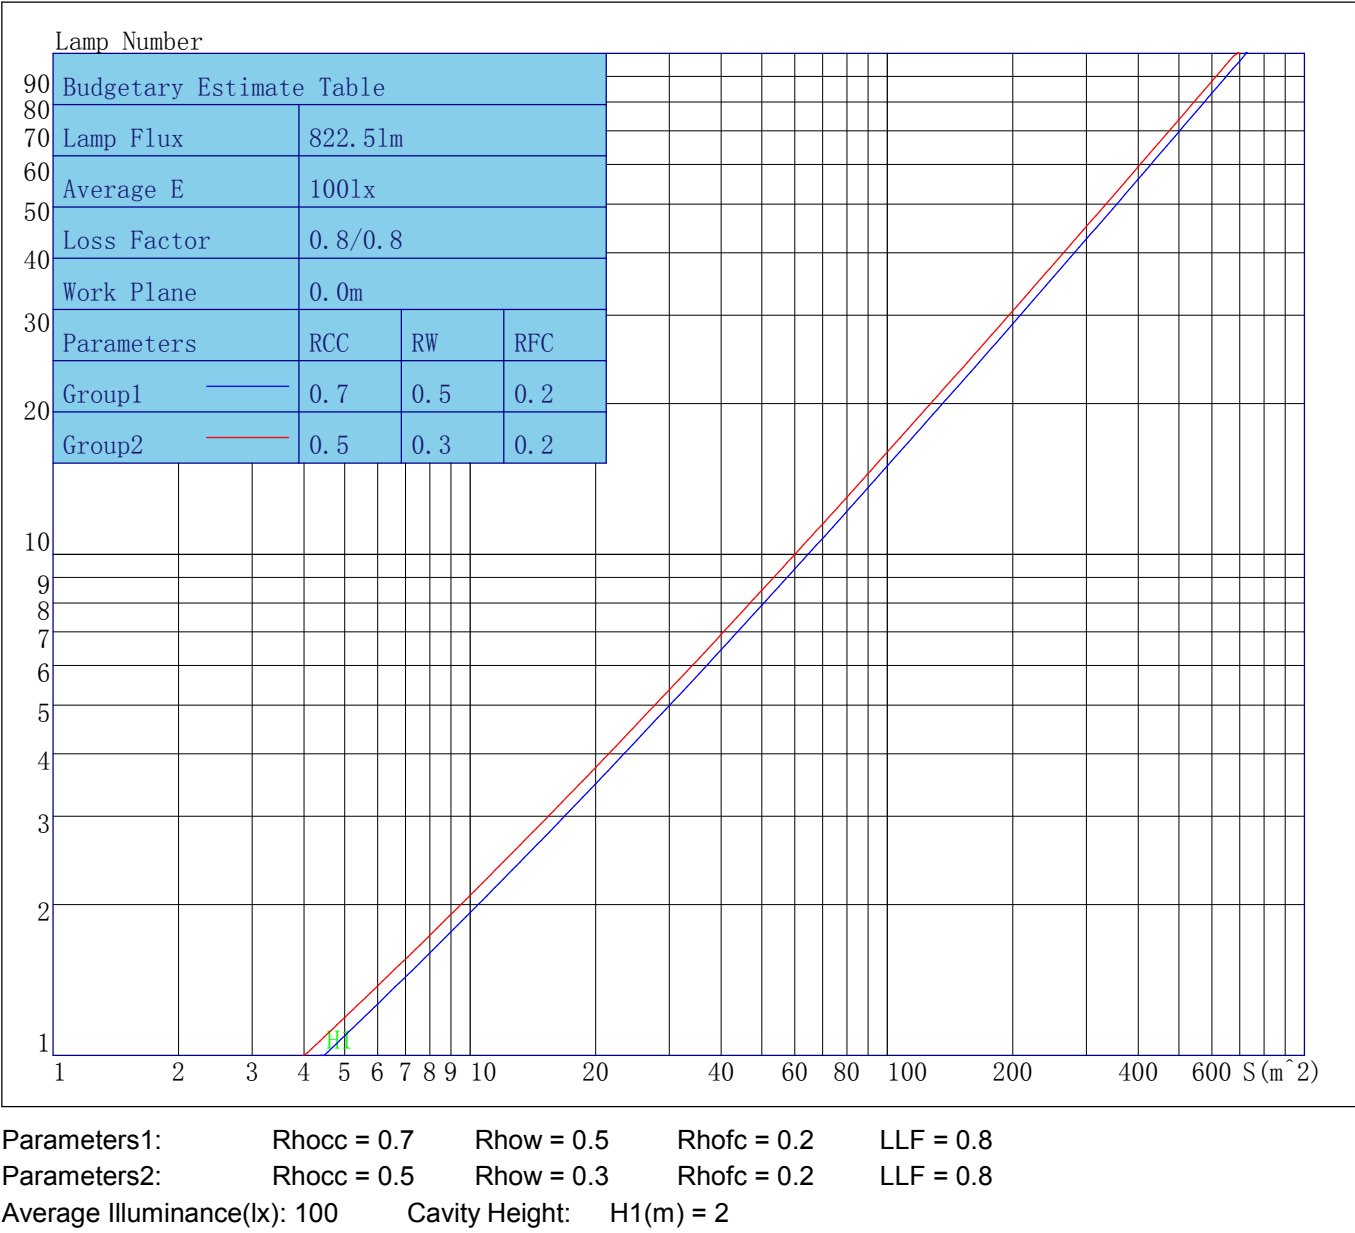

Indoor Coefficient of Utilization Table

Coefficients of Utilization - Zonal Cavity Method																		
Coef.	Effective Floor Cavity Reflectance RFC=0.20																	
RhoCC (%)	80				70				50			30			10			0
RhoW (%)	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR	Coefficient of Utilization(%)																	
0	130	130	130	130	127	127	127	127	121	121	121	115	115	115	110	110	110	108
1	124	121	118	116	121	118	116	114	114	112	110	110	108	107	106	104	103	101
2	118	113	109	105	116	111	107	104	107	104	101	104	101	99	101	99	97	95
3	113	106	101	97	110	104	100	96	101	97	94	99	95	92	96	93	91	89
4	107	100	94	90	105	98	93	89	96	91	88	94	90	87	92	88	86	84
5	103	94	88	84	101	93	88	83	91	86	83	89	85	82	87	84	81	79
6	98	89	83	79	97	88	83	79	87	82	78	85	81	77	84	80	77	75
7	94	85	79	74	93	84	78	74	83	77	74	81	77	73	80	76	73	71
8	90	81	75	71	89	80	74	70	79	74	70	78	73	70	77	72	69	68
9	87	77	71	67	86	77	71	67	75	70	67	74	70	67	73	69	66	65
10	83	74	68	64	82	73	68	64	72	67	64	71	67	64	71	66	63	62

Unified Glare Rating Table

Unified Glare Rating Table											
Ceiling RCC		0.70	0.70	0.50	0.50	0.30	0.70	0.70	0.50	0.50	0.30
Wall RW		0.50	0.30	0.50	0.30	0.30	0.50	0.30	0.50	0.30	0.30
Floor RFC		0.20	0.20	0.20	0.20	0.20	0.20	0.20	0.20	0.20	0.20
Room Size		Vewed crosswise					Vewed endwise				
X=2H	Y=2H	20.0	21.2	20.4	21.5	21.9	19.9	21.0	20.3	21.4	21.7
	Y=3H	20.3	21.4	20.7	21.7	22.1	20.1	21.1	20.5	21.5	21.9
	Y=4H	20.4	21.4	20.8	21.8	22.2	20.1	21.1	20.5	21.5	21.9
	Y=6H	20.5	21.4	20.9	21.8	22.2	20.1	21.0	20.5	21.4	21.8
	Y=8H	20.5	21.4	20.9	21.8	22.2	20.1	21.0	20.5	21.4	21.8
	Y=12H	20.5	21.4	21.0	21.8	22.2	20.1	20.9	20.5	21.3	21.8
X=4H	Y=2H	20.0	21.0	20.4	21.4	21.8	19.9	20.9	20.3	21.2	21.6
	Y=3H	20.4	21.3	20.9	21.7	22.1	20.1	21.0	20.6	21.4	21.8
	Y=4H	20.6	21.4	21.0	21.8	22.3	20.2	21.0	20.7	21.4	21.9
	Y=6H	20.7	21.4	21.2	21.9	22.4	20.2	20.9	20.7	21.4	21.9
	Y=8H	20.8	21.4	21.2	21.9	22.4	20.2	20.9	20.7	21.4	21.9
	Y=12H	20.9	21.5	21.4	22.0	22.5	20.3	20.9	20.8	21.4	21.9
X=8H	Y=4H	20.5	21.2	21.0	21.7	22.1	20.1	20.8	20.6	21.3	21.8
	Y=6H	20.7	21.3	21.2	21.8	22.4	20.2	20.8	20.7	21.3	21.9
	Y=8H	20.8	21.4	21.3	21.9	22.4	20.2	20.8	20.8	21.3	21.8
	Y=12H	21.0	21.5	21.5	22.0	22.6	20.3	20.8	20.8	21.3	21.9
X=12H	Y=4H	20.5	21.1	21.0	21.6	22.1	20.1	20.7	20.6	21.2	21.7
	Y=6H	20.7	21.2	21.2	21.7	22.3	20.2	20.7	20.7	21.2	21.8
	Y=8H	20.8	21.3	21.4	21.8	22.4	20.2	20.7	20.8	21.2	21.8
Variations with the objerver position at spacings											
S=1.0H		0.3/-0.3					0.5/-0.5				
S=1.5H		0.8/-0.8					1.0/-1.0				
S=2.0H		1.3/-1.2					1.7/-1.7				
Reduced UGR Table:											
Nordic Standard Table:		BK0					BK0				
Correction Value		1.1					0.8				

o the CIE Pub.117, data has been corrected, refers to the lamp's lumens 8.2flm.

IES EQUIVALENT
Photometric Filename:KA9L36BTC.IES

Candela Tabulation

V/H	C0.0	C90.0	C180.0	C270.0
γ 0.0	1668.97	1668.97	1668.97	1668.97
γ 1.0	1676.71	1674.85	1655.58	1668.65
γ 2.0	1676.54	1668.96	1635.94	1660.19
γ 3.0	1673.07	1662.19	1614.08	1644.68
γ 4.0	1665.23	1642.43	1584.26	1622.38
γ 5.0	1653.26	1625.96	1549.37	1594.92
γ 6.0	1633.21	1599.98	1509.30	1560.06
γ 7.0	1609.52	1570.79	1465.15	1517.57
γ 8.0	1578.93	1534.18	1415.15	1466.14
γ 9.0	1541.10	1494.64	1361.31	1411.36
γ 10.0	1496.81	1447.13	1300.34	1352.38
γ 11.0	1446.22	1396.82	1235.86	1291.01
γ 12.0	1388.35	1342.19	1164.87	1221.83
γ 13.0	1329.81	1283.32	1093.35	1150.79
γ 14.0	1267.36	1215.28	1018.82	1074.23
γ 15.0	1200.05	1140.70	946.76	999.11
γ 16.0	1128.71	1065.75	873.17	924.94
γ 17.0	1052.78	993.60	803.13	853.38
γ 18.0	979.49	920.86	734.07	783.69
γ 19.0	907.35	852.30	669.67	716.13
γ 20.0	835.27	784.68	607.75	651.40
γ 21.0	765.93	719.19	549.62	590.41
γ 22.0	699.66	655.66	493.59	531.92
γ 23.0	635.67	595.70	443.74	477.19
γ 24.0	575.01	539.23	396.96	426.02
γ 25.0	517.99	487.50	354.33	379.57
γ 26.0	465.17	439.02	316.07	338.00
γ 27.0	416.16	395.15	282.53	301.25
γ 28.0	371.55	354.11	251.27	267.81
γ 29.0	331.08	318.14	223.63	238.97
γ 30.0	294.90	285.31	198.23	212.78
γ 31.0	262.72	256.02	176.09	189.12
γ 32.0	234.19	229.16	156.43	168.09
γ 33.0	208.83	205.11	139.06	149.76
γ 34.0	186.19	183.05	124.07	133.35
γ 35.0	166.13	163.89	110.99	118.80
γ 36.0	148.23	146.78	98.94	105.99
γ 37.0	132.26	131.89	88.45	94.84
γ 38.0	118.19	118.51	79.39	85.17
γ 39.0	106.02	106.74	71.81	76.96
γ 40.0	95.24	95.94	64.92	69.54
γ 41.0	85.91	86.68	59.09	63.23
γ 42.0	77.66	78.35	54.01	57.52
γ 43.0	70.42	71.24	49.66	52.52
γ 44.0	64.11	64.89	45.77	48.08
γ 45.0	58.65	59.40	42.37	44.41
γ 46.0	53.82	54.43	39.20	40.92

IES EQUIVALENT
Photometric Filename:KA9L36BTC.IES

Candela Tabulation - (Cont.)

V/H	C0.0	C90.0	C180.0	C270.0
γ 47.0	49.65	50.05	36.52	37.95
γ 48.0	45.94	46.06	33.91	35.18
γ 49.0	42.70	42.48	31.54	32.76
γ 50.0	39.69	39.19	29.30	30.59
γ 51.0	36.86	36.29	27.27	28.63
γ 52.0	34.29	33.65	25.36	26.77
γ 53.0	31.98	31.24	23.60	25.07
γ 54.0	29.81	28.89	21.93	23.49
γ 55.0	27.77	26.78	20.43	22.10
γ 56.0	25.91	24.82	19.03	20.76
γ 57.0	24.18	23.04	17.74	19.48
γ 58.0	22.53	21.36	16.47	18.25
γ 59.0	21.04	19.78	15.31	17.14
γ 60.0	19.61	18.32	14.18	16.05
γ 61.0	18.27	16.96	13.06	15.03
γ 62.0	17.03	15.68	12.01	14.03
γ 63.0	15.88	14.45	11.08	13.11
γ 64.0	14.77	13.29	10.07	12.17
γ 65.0	13.72	12.19	9.30	11.26
γ 66.0	12.70	11.11	8.50	10.44
γ 67.0	11.74	10.21	7.66	9.65
γ 68.0	10.77	9.23	7.04	8.92
γ 69.0	9.95	8.43	6.44	8.19
γ 70.0	9.11	7.54	5.83	7.57
γ 71.0	8.38	6.87	5.28	7.02
γ 72.0	7.74	6.24	4.78	6.42
γ 73.0	7.12	5.61	4.29	5.84
γ 74.0	6.53	5.03	3.83	5.30
γ 75.0	5.95	4.50	3.41	4.82
γ 76.0	5.39	3.98	3.01	4.34
γ 77.0	4.91	3.54	2.65	3.89
γ 78.0	4.43	3.11	2.45	3.48
γ 79.0	3.98	2.71	2.28	3.21
γ 80.0	3.58	2.44	2.11	3.00
γ 81.0	3.28	2.27	1.97	2.82
γ 82.0	3.07	2.09	1.82	2.64
γ 83.0	2.88	1.94	1.69	2.47
γ 84.0	2.70	1.79	1.55	2.32
γ 85.0	2.54	1.65	1.42	2.16
γ 86.0	2.37	1.53	1.27	1.94
γ 87.0	2.22	1.40	1.10	1.80
γ 88.0	2.09	1.27	0.94	1.66
γ 89.0	1.94	1.12	0.85	1.51
γ 90.0	1.76	0.97	0.80	1.41
γ 91.0	1.59	0.85	0.73	1.32
γ 92.0	1.48	0.78	0.67	1.24
γ 93.0	1.39	0.73	0.62	1.18

IES EQUIVALENT
Photometric Filename:KA9L36BTC.IES

Candela Tabulation - (Cont.)

V/H	C0.0	C90.0	C180.0	C270.0
γ 94.0	1.32	0.65	0.56	1.11
γ 95.0	1.25	0.61	0.52	1.04
γ 96.0	1.17	0.56	0.47	0.98
γ 97.0	1.11	0.51	0.43	0.92
γ 98.0	1.04	0.47	0.39	0.87
γ 99.0	0.99	0.41	0.36	0.82
γ 100.0	0.93	0.37	0.33	0.79
γ 101.0	0.87	0.34	0.30	0.73
γ 102.0	0.82	0.29	0.28	0.69
γ 103.0	0.78	0.26	0.26	0.65
γ 104.0	0.73	0.23	0.23	0.63
γ 105.0	0.69	0.20	0.23	0.61
γ 106.0	0.65	0.17	0.20	0.57
γ 107.0	0.62	0.15	0.19	0.56
γ 108.0	0.58	0.12	0.18	0.54
γ 109.0	0.55	0.09	0.18	0.51
γ 110.0	0.51	0.08	0.17	0.50
γ 111.0	0.49	0.06	0.19	0.51
γ 112.0	0.46	0.05	0.18	0.49
γ 113.0	0.43	0.04	0.20	0.49
γ 114.0	0.42	0.02	0.21	0.49
γ 115.0	0.41	0.03	0.23	0.50
γ 116.0	0.40	0.03	0.25	0.51
γ 117.0	0.39	0.03	0.28	0.52
γ 118.0	0.38	0.04	0.31	0.54
γ 119.0	0.38	0.04	0.35	0.58
γ 120.0	0.40	0.06	0.40	0.60
γ 121.0	0.40	0.08	0.44	0.64
γ 122.0	0.41	0.11	0.49	0.68
γ 123.0	0.44	0.14	0.55	0.73
γ 124.0	0.46	0.18	0.62	0.79
γ 125.0	0.49	0.22	0.70	0.84
γ 126.0	0.53	0.27	0.77	0.90
γ 127.0	0.57	0.34	0.85	0.98
γ 128.0	0.62	0.40	0.94	1.04
γ 129.0	0.68	0.46	1.04	1.13
γ 130.0	0.75	0.53	1.14	1.21
γ 131.0	0.81	0.62	1.25	1.31
γ 132.0	0.89	0.71	1.36	1.41
γ 133.0	0.97	0.80	1.48	1.51
γ 134.0	1.06	0.90	1.60	1.62
γ 135.0	1.16	1.01	1.72	1.74
γ 136.0	1.26	1.12	1.85	1.85
γ 137.0	1.37	1.24	1.98	1.97
γ 138.0	1.48	1.36	2.10	2.09
γ 139.0	1.60	1.48	2.24	2.23
γ 140.0	1.72	1.61	2.38	2.34

Candela Tabulation - (Cont.)

V/H	C0.0	C90.0	C180.0	C270.0
γ 141.0	1.86	1.75	2.51	2.48
γ 142.0	1.98	1.87	2.64	2.60
γ 143.0	2.10	2.01	2.78	2.72
γ 144.0	2.24	2.14	2.91	2.85
γ 145.0	2.37	2.27	3.04	2.98
γ 146.0	2.50	2.40	3.17	3.10
γ 147.0	2.64	2.53	3.29	3.22
γ 148.0	2.76	2.66	3.40	3.34
γ 149.0	2.88	2.78	3.54	3.46
γ 150.0	3.02	2.91	3.63	3.55
γ 151.0	3.14	3.03	3.75	3.66
γ 152.0	3.26	3.15	3.85	3.76
γ 153.0	3.38	3.26	3.94	3.86
γ 154.0	3.49	3.37	4.02	3.93
γ 155.0	3.59	3.46	4.12	4.00
γ 156.0	3.70	3.56	4.19	4.09
γ 157.0	3.80	3.66	4.25	4.14
γ 158.0	3.88	3.73	4.30	4.21
γ 159.0	3.96	3.82	4.37	4.26
γ 160.0	4.04	3.89	4.41	4.31
γ 161.0	4.10	3.95	4.45	4.34
γ 162.0	4.18	4.01	4.48	4.38
γ 163.0	4.23	4.06	4.50	4.40
γ 164.0	4.28	4.12	4.53	4.42
γ 165.0	4.32	4.16	4.54	4.44
γ 166.0	4.37	4.20	4.56	4.46
γ 167.0	4.41	4.23	4.57	4.48
γ 168.0	4.44	4.25	4.58	4.49
γ 169.0	4.47	4.28	4.60	4.49
γ 170.0	4.50	4.32	4.61	4.50
γ 171.0	4.53	4.33	4.61	4.53
γ 172.0	4.55	4.36	4.64	4.54
γ 173.0	4.57	4.37	4.64	4.54
γ 174.0	4.59	4.42	4.68	4.57
γ 175.0	4.63	4.43	4.68	4.58
γ 176.0	4.64	4.46	4.69	4.61
γ 177.0	4.66	4.49	4.71	4.61
γ 178.0	4.68	4.50	4.72	4.63
γ 179.0	4.70	4.53	4.72	4.64
γ 180.0	4.68	4.68	4.68	4.68